

# Technical Specification Sheet

**Flame Scanner - ITS 967X7179M372**  
**Honeywell : LG1093AA24**

Valid from 2018.03.29



CE Ex II 3 G Ex d IIC T3 Gc

## Overview

As our flame scanners have evolved to an inherent part of our spare part portfolio, we continuously invest in research and development. Our flame scanners has been advanced to provide reliable information about flame intensity in the combustion chamber of gas turbines.

ITS flame scanner has been designed to detect the ultraviolet radiation emitted by a hydrocarbon flame. The result of this measurement is converted to pulse outputs which correlates to the intensity of the ultraviolet radiation. Based on a programmable threshold setting, the control system is able to determine whether there is flame or not.

The advantages of our products are:

- Higher sensitivity
- Larger spectral region
- Longer life time
- Low maintenance
- No mounting modifications required
- No changes in the controls required
- Short delivery lead time

## **Application**

ITS flame scanners are currently used on land based as well as on offshore industrial heavy duty gas turbines. They have been designed for safe operation of General Electric gas turbine frames 5, 6, 7 and 9.

## **Mode of Operation**

When ultraviolet rays from an open flame hit the cathode leg of the sensor, the gas in the detector is ionized and photoelectrons are generated from the cathode.

The electrons and positive ions are accelerated towards the anode and cathode, creating more free electrons in the process. A burst of current flow is created by the avalanche effect. This burst of current will 'discharge' the detector by causing a drop in the potential difference across the anode and cathode. As a result, the avalanche effect is stopped, and the voltages at the anode and cathode start to build up again.

The cycle as described above will repeat as long as there is a presence of ultraviolet radiation. The frequency of the pulses (the number of generated pulses per second) depends on the intensity of the ultraviolet radiation.

## **Installation Instructions**

The flame scanner is intended to be connected to a conduit system. A certified conduit stopping box (a type of protective flameproof enclosure „d“) shall be fitted immediately at the entrance of the enclosure. The stopping box must be suitable for the ambient temperature range and should be installed correctly.


For external earthing or bonding connection the cable lug shall be used in such a manner that the conductor is secured against loosening and twisting and that contact pressure is permanently secured.

## **Functioning Life-Time**

The unit is designed and manufactured for a life of not less than 2 (two) years or 16,000 (sixteen thousand) operating hours.

## **Shelf Life**

The flame scanner will be working within the design values stated in this specification without adjustments or replacements of parts after an unused period of 12 months, preconditioned that the flame scanner had been prepared for storage and was stored in a manner that is at least equal to that of the original packaging by ITS. The Purchaser shall evaluate, review and approve each and every packaging received by ITS.

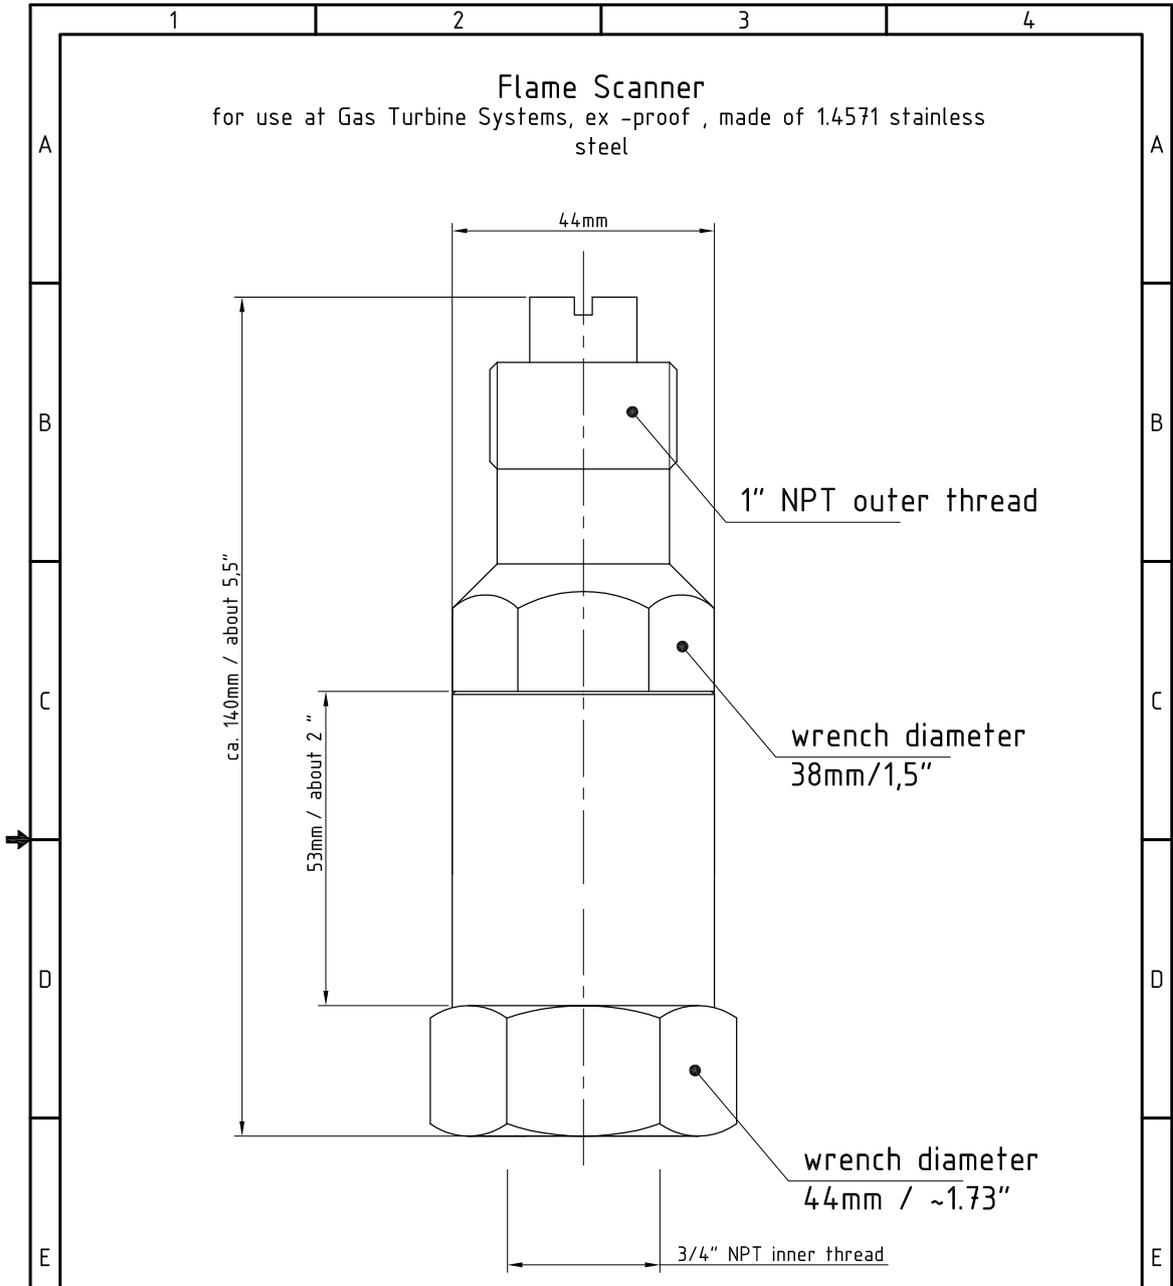

© Copyright by ITS-Industrial Turbine Services GmbH, proprietary information - this document contains information of Industrial Turbine Services GmbH and may not be used or disclosed to others, except with the written permission of Industrial Turbine Services GmbH. Weitergabe sowie Vervielfältigung dieser Unterlage, Verwertung und Mitteilung ihres Inhaltes sind nur mit ausschließlicher Genehmigung der ITS - Industrial Turbine Services GmbH gestattet. Alle Rechte vorbehalten.

		free dimension tolerance medium DIN ISO 2768	surface by DIN ISO 1302	Scale 1:1		
		oxygen cutting/welding by DIN 2310 / DIN 8570	design and coat tolerances by DIN ISO 1101	Material 1.4571 stainless steel		
			Name		Flame Scanner Dimensions	
			Date			
			Arrn. 25.11.2004 Dörsch			
			Proof. 28.07.2005 Finsterm.T.			
			Comm. 28.07.2005 Finsterm.T.		Drawing Number	
			Norm		TS 967X7179M372 0007	
REV 2 for customer information	09.01.2013	Burges			Format A4	cap. 1
REV 1 for customer information	10.12.2012	Schindler			shf. 6	
ISO-Anpassung	28.07.05	Dörsch St	repl. f.: TS 967X 7179 M372		repl. d.:	
Zust. Change	Date	Name	Urspr.			

**ITS 967X7179M372 (Honeywell : LG1093AA24) Flame Scanner Characteristics**

<b>Parameters</b>	<b>Details</b>
Manufacturer	ITS Industrial Turbine Services, Austria
Sensor	UV Flame Scanner
Housing	1.4571 stainless steel
Window	Fused Silica
Mounting	3/4" internal NPT
Working Temperature	-40°C (-40°F) to 177°C (350°F)
Pressure sealing	Against 21bar (300 psi) at 316°C (600°F) continuously
Cable characteristics	Material: PTFE, cover color: orange Lead colors: GRN (GND), BLK (+), YEL (-)
Lead length	4.9m (16 Ft ± 1 Ft)
Average Spectral Sensitivity	190 - 290nm, 250cpm = $10^{-13} \text{W/cm}^2 \lambda:200\text{nm}$
Discharge Starting Voltage <sup>(1)</sup>	< 260VDC
Background <sup>(2)</sup>	< 5 min <sup>-1</sup>
Response Time	<200ms
Recommended Operating Volt Range	260 - 350VDC amplifier, recommended 325VDC ± 25VDC
Pulse Output <sup>(3)</sup>	Pulse 275 sec <sup>-1</sup> ± 25 sec <sup>-1</sup> , continuous flame > 15Hz
Sensor Vibration	Continuous vibration of up to 0.7 in/sec @ 200 Hz and up to .35 in/sec @ 500 Hz or equivalent of 2.5 g acceleration

*Note: Continuous product development may make it necessary to change these details without notice*

(1) Discharge Starting Voltage - Voltage where the sensor just starts its discharge under UV radiation.

(2) Background - Output count that is measured under room illuminations (approximately 500 lx) at recommended operating voltage

(3) Pulse Output - Flame intensity in counts/sec measured with a pulse counter.